




**PORT O' CONNOR IMPROVEMENT DISTRICT
39 DENMAN DR
(361) 983-2652**

SEWER HOOKUP INSTRUCTIONS

1. **A "SEWER CHECK VALVE" PREVENTION DEVICE MUST BE INSTALLED.**
2. **4" SCHEDULE 40 PVC PIPE OR SDR 26 PIPE IS REQUIRED. ALL PIPING MUST BE GLUED.**
3. **GRAVITY LINE FROM HOUSE TO PIT LEG MUST HAVE A MINIMUM 2% SLOPE.**
4. **RUN PIPE TO CLOSEST PROXIMITY OF PIT UP TO UTILITY EASEMENT.**
5. **LEG ON PIT IS APPROXIMATELY 54" DEEP.**
6. **ONCE PIPE IS RUN-CALL DISTRICT AT (361) 983-2652 FOR INSPECTION BEFORE COVERING PIPE UP. FINAL HOOK-UP BY PLUMBER AT TIME OF FINAL INSPECTION**

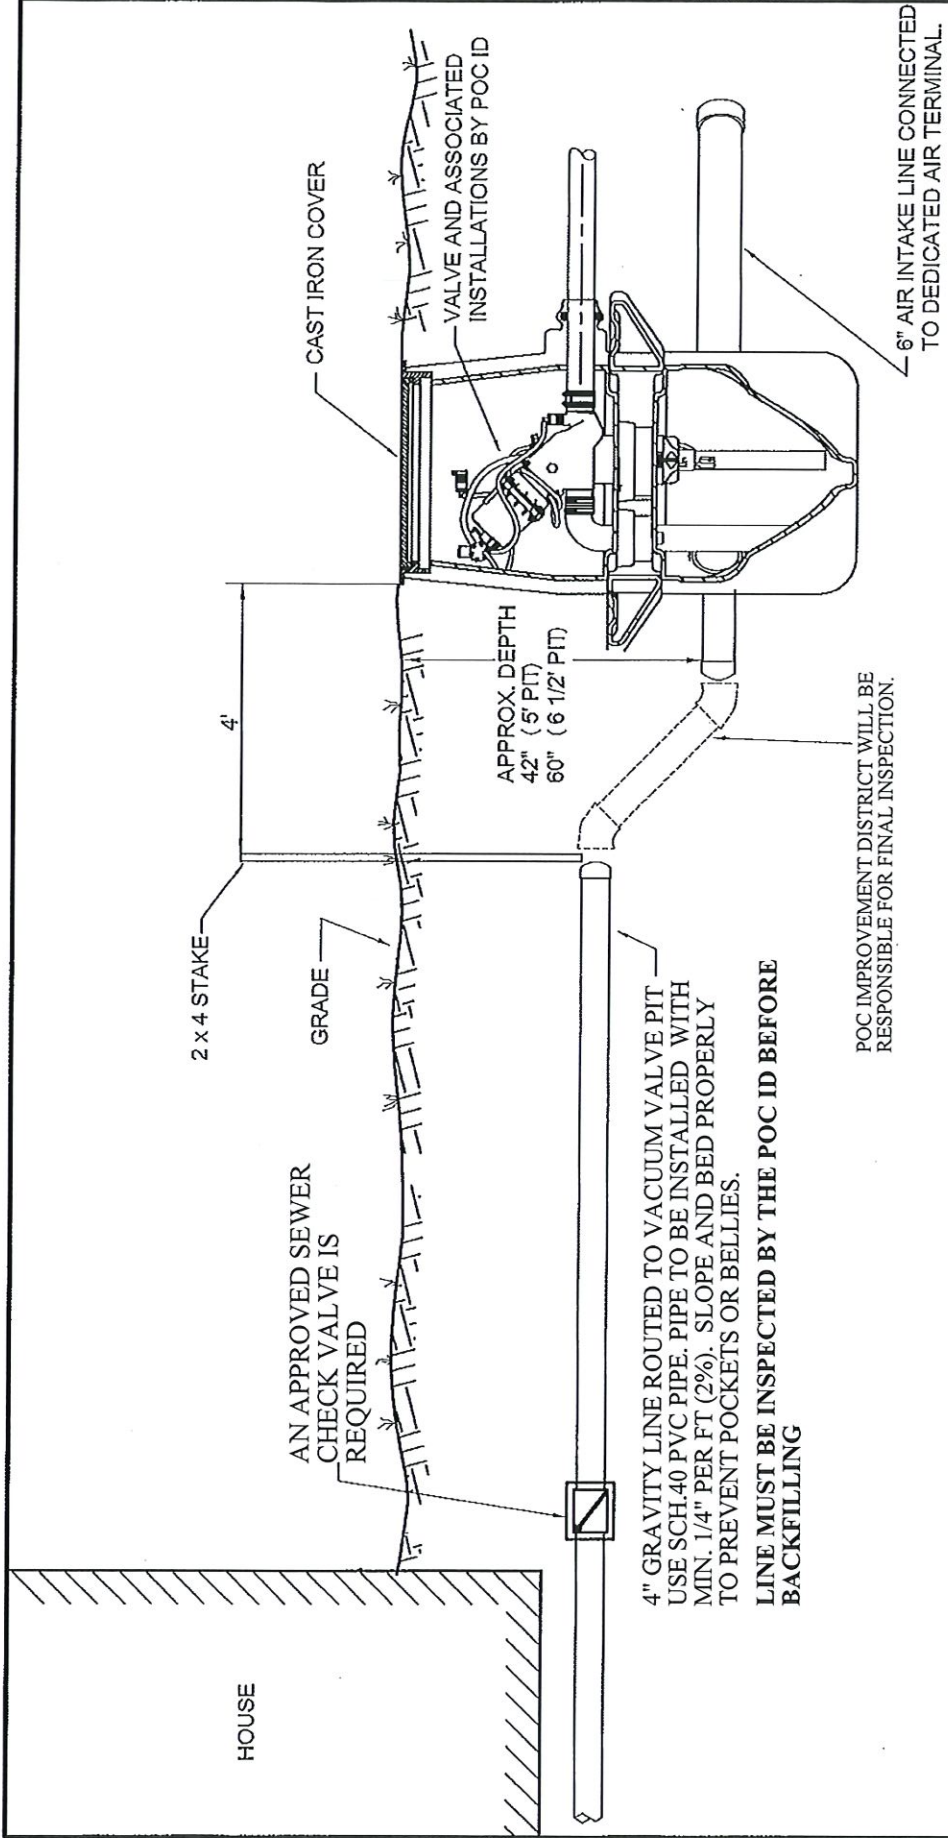

VALVE PIT AFTER HOME HOOK-UP -- SD - 19
6" AIR-INTAKE AT THE VALVE PIT

DRAWN BY: DJG
 JOB NO.: 1530.000
 SCALE: NONE
 DATE: 4-24-14
 AMENDED: 12-13-19

PORT O'CONNOR IMPROVEMENT DISTRICT

38 Denman Drive · Port O'Connor, Texas · 77982
 PH: 361-983-2652 · FAX: 361-983-2285

